



**FRONT VIEW**

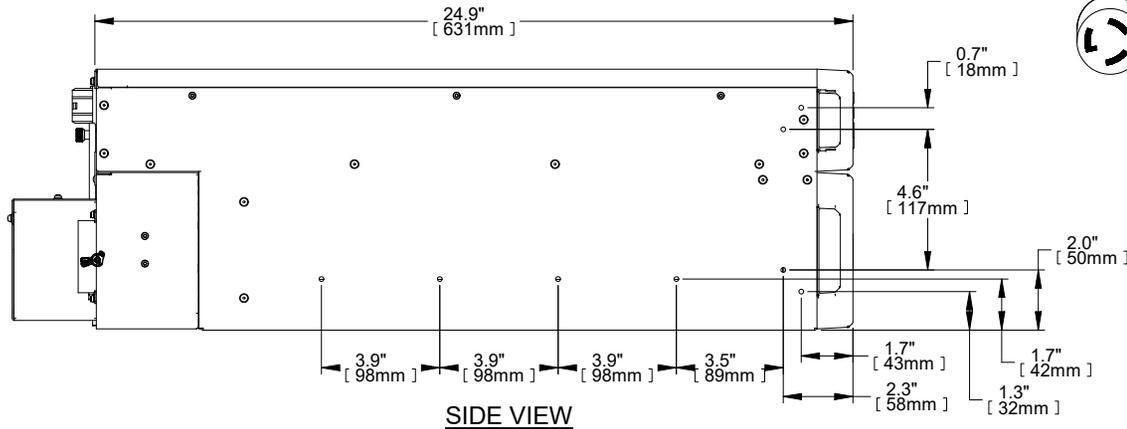

**SIDE VIEW**

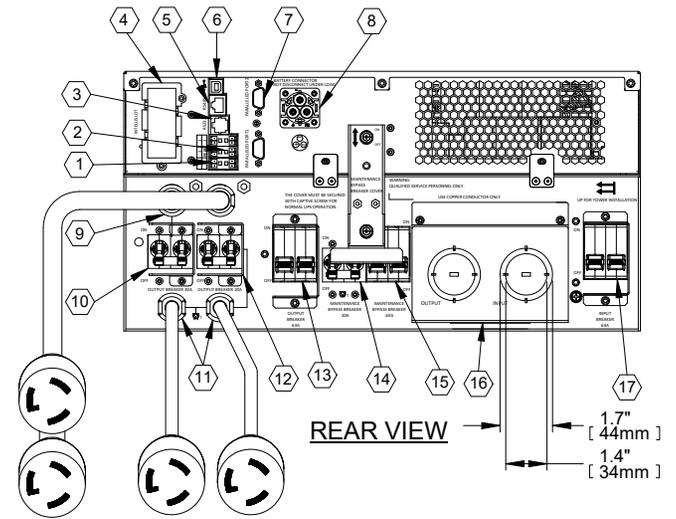

**REAR VIEW**

- |  |   |
|--|---|
| ① TERMINAL BLOCK COMMUNICATION           | ⑩ L6-30R OUTPUT BREAKER   |
| ② REPO (REMOTE EMERGENCY POWER OFF)      | ⑪ (2) PROGRAMMABLE L6-20R OUTPUT RECEPTACLE   |
| ③ RS232                                  | ⑫ PROGRAMMABLE L6-20R OUTPUT BREAKER  |
| ④ LIEBERT INTELLISLOT PORT               | ⑬ OUTPUT CIRCUIT BREAKER FOR HARDWIRED CONNECTIONS AND NON-PROGRAMMABLE OUTLETS     |
| ⑤ RS485                                  | ⑭ MAINTENANCE BYPASS BREAKER FOR PROGRAMMABLE OUTLETS                               |
| ⑥ USB PORT                               | ⑮ MAINTENANCE BYPASS BREAKER FOR HARDWIRED CONNECTIONS AND NON-PROGRAMMABLE OUTLETS |
| ⑦ (2) DB9 PORTS (PARALLEL COMMUNICATION) | ⑯ HARDWIRED POWER INPUT AND OUTPUT CONNECTIONS                                      |
| ⑧ EXTERNAL BATTERY CONNECTOR             | ⑰ INPUT CIRCUIT BREAKER   |
| ⑨ (2) L6-30R OUTPUT RECEPTACLE           |   |

**NOTES:**

- UNIT DIMENSIONS (WxDxH): 430mm x 631mm x 217mm (5U) (16.9") x (24.9") x (8.5")
- UNIT WEIGHT: 70.0kg (154.3lbs)
- SHIPPING DIMENSIONS (WxDxH): 646mm x 816mm x 520mm (25.4") x (32.1") x (20.5")
- SHIPPING WEIGHT: 94.0kg (207.2lbs)
- MINIMUM AIRFLOW CLEARANCE IS 4.0" (100mm) FRONT AND REAR.

DRAWN BY B. LAY	SHEET NO. 1 OF 1
CHK BY L. JOHNSON	ECN NO.
REF. DWG.	ORDER NO.

OUTLINE DRAWING  
GXT5 8/10kVA  
208VAC RACK/TOWER UPS

DWG. NO. GXT5-8K 10KHV OD	DATE 11/5/19	REV. # 1	1050 DEARBORN DRIVE P.O. BOX 29186 COLUMBUS, OHIO 43229
------------------------------	-----------------	-------------	---

FILE NAME: I:\dpgeng\GXT5\Submittals(A)\Outline Dwg\GXT5-8K\_10KHV\_OD

